




**Cat# 71712**  
**LED Linear High Bay**  
**120W**



Model :		71712
<b>OVERALL LAMP PARAMETERS</b>	Input Voltage	100-277VAC
	Input Current	1.0209A
	Input Power	122 W
	Power Factor	PF≥0.99
	Luminance	15198 LM
	Luminous Efficiency	125 LM/W
	CRI	≥82
	Beam Angle	120°
	Main Structure	Heavy Gauge Steel Housing
	Surface	White Powder Coat Finish
	Lens	Clear Polycarbonate
<b>LED DRIVER</b>	Output Voltage	40-66V
	Output Current	1150mA
	Driver Efficiency	92%
	LED Manufacturer	Towin
	LED Efficacy	128 lm/W
	Color Temperature	5000K
<b>LIFESPAN &amp; ENVIRONMENT</b>	Lifespan	50000 Hrs.
	Warranty	5 Years
	Operating Temperature	-22°F— +104°F
<b>OTHERS</b>	Diamension	Pls refer to attached dimension drawing
	Net Weight(Kg)	4.3
	Gross Weight(Kg)	6
	Box Size	--
	Carton Size(mm)	68.5*50*10
	Q'ty / Carton	1

Dimension: 71712

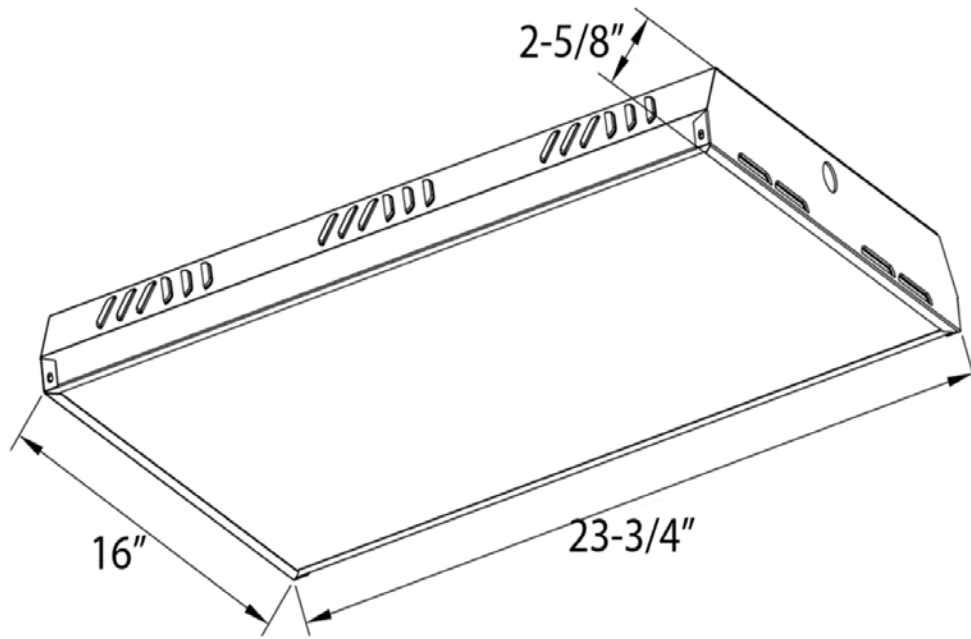



NVLAP LAB CODE:201045-0



Shenzhen Anbotek Compliance Laboratory Limited

## IES LM-79-08 TEST REPORT For Morris Products Inc.

**Report Number:** R011510131L

**Product Type:** High-bay Luminaires for Commercial and Industrial Buildings

**Date of Receipt:** 2015-10-14

**Date of Test:** 2015-10-15 to 2015-10-21

**Date of Report:** 2015-10-22

**Product Model:** 71712

**Product Description:** AC100-277V 50/60Hz 120W 5000K

**Product Criteria:** IES LM-79-08: Electrical and Photometric Measurements of Solid-State Lighting Products

**Prepared By:** Shenzhen Anbotek Compliance Laboratory Limited  
1/F., Building 1, SEC Industrial Park, No.0409 Qianhai Road,Nanshan District,Shenzhen, Guangdong, China  
Tel: +86 755 2606 6544  
Fax: +86 755 26014772  
Web: www.anbotek.com

**Tested By:** Rain Chen

**Reviewed By:** Vic Zhou/Energy Lab Manager

Note: This test report is prepared for the customer shown above and for the device described herein. It may not be duplicated or use in part without prior written consent from Shenzhen Anbotek Compliance Laboratory Limited. This report must not be used by the customer to claim product certification, approval, or endorsement By NVLAP, NIST, or any agency of the Federal Government.

---

## TABLE OF CONTENTS

1 – GENERAL.....	3
1.1 Product description.....	3
1.2 Standard of method.....	3
1.3 Test Facility.....	3
2 – Test Equipment List and Details.....	4
3 - Test Method.....	5
3.1 Ambient Condition.....	5
3.2 Power Supply Characteristics.....	5
3.3 Seasoning and Stabilization.....	5
3.4 Integrating Sphere System.....	5
3.5 Goniophotometer System.....	5
4-Test Result.....	6
4.1 Photometric test with Integrating Sphere System.....	6
4.2 Photometric test with Goniophotometer System.....	9
5-Additional Test.....	14
Attachment A – Product PHOTO.....	15

---

## 1 – GENERAL

---

### 1.1 Product description

#### General Information

<b>Applicant</b>	Morris Products Inc.
<b>Applicant Address</b>	53 Carey Rd, Queensbury, NY 12804
<b>Manufacturer</b>	Morris Products Inc.
<b>Manufacturer Address</b>	53 Carey Rd, Queensbury, NY 12804
<b>Brand name</b>	Morris
<b>Test Model Number</b>	71712
<b>Burning time before test</b>	0 Hours (For new products)

#### Rated Values

<b>Rated Inputs</b>	AC100-277V 50/60Hz
<b>Rated Power</b>	120W
<b>Nominal CCT</b>	5000K

### 1.2 Standard of method

- ANSI C78.377-2011: Specifications for the Chromaticity of Solid State Lighting Products
- ANSI C82.77-2002: Harmonic Emission Limits-Related Power Quality Requirements for Lighting Equipment
- CIE Publication No.13.3-1995: Method of Measuring and Specifying Color Rendering of Light Sources
- IESNA LM-79-08 Approved Method: Electric & Photometric Measurement of Solid-state Lighting Products

### 1.3 Test Facility

The test facility used by Shenzhen Anbotek Compliance Laboratory Limited is located at 1/F., Building 1, SEC Industrial Park, No.0409 Qianhai Road, Nanshan District, Shenzhen, Guangdong, China.

## 2 – Test Equipment List and Details

Device	Manufacture	Model No	Serial No	Test Range	Calibration date	Calibration due date
Goniophotometric System	SENSING	GMS-3000	-	-	2015-03-16	2016-03-15
AC Power Source	Ainuo	AN97001W	-	0-300V, 1000VA	2015-03-16	2016-03-15
Digital Power Meter	YOKOGAWA	WT310		0-600V/0-10A/0-100Hz	2015-03-16	2016-03-15
Temperature & Humidity meter	XINIXI	CTH-608	-	0°C~50°C, 10% to 90%RH	2015-03-16	2016-03-15
Total Luminous Flux Standard Lamp	SENSING	220V/500W	S135009	220V/500W	2015-03-16	2016-03-15
Total Luminous Flux Standard Lamp	SENSING	220V/500W	S1350014	220V/500W	2015-03-16	2016-03-15
1.5m Integral Sphere	SENSING	SPR-600M	-	380nm-780nm,0.011m <sup>2</sup> ~6.00×10 <sup>5</sup> lm	2015-03-16	2016-03-15
Spectrum analyzer	SENSING	SPR-3000	-	380nm-780nm,0.011m <sup>2</sup> ~6.00×10 <sup>5</sup> lm	2015-03-16	2016-03-15
AC Power Source	ALL POWER	APW-110N	997079	0-300V, 0-1000VA	2015-07-15	2016-07-14
Digital Power Meter	YOKOGAWA	WT210	-	0-600V/0-10A/0-100Hz	2015-03-16	2016-03-15
DC Power Supply	Link Color	Link Color	-	DC 30V, 5A	2015-03-16	2016-03-15
Total Luminous Flux Standard Lamp	SENSING	110 V / 100 W	S13100190	Refer specification	2015-03-16	2016-03-15
Total Luminous Flux Standard Lamp	SENSING	110 V / 100 W	S1310034	Refer specification	2015-03-16	2016-03-15
Temperature & Humidity meter	XINIXI	CTH-608	-	0°C~50°C, 10% to 90%RH	2015-03-16	2016-03-15

Statement of Traceability: Shenzhen Anbotek Compliance Laboratory Limited attests that all calibration has been performed using suitable standards traceable to national primary standards and International System of Unit (SI).

---

## **3 - Test Method**

---

### **3.1 Ambient Condition**

The ambient temperature in which measurements are being taken was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ , the air flow around the sample(s) being tested did not affect the performance.

### **3.2 Power Supply Characteristics**

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within  $\pm 0.2$  percent under load.

### **3.3 Seasoning and Stabilization**

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

### **3.4 Integrating Sphere System**

The system includes AC power source, digital power meter, DC power supply, spectrophotometer, and integrating sphere. The integrating sphere system is calibrated by standard light source before measurement. The system and standard light source has been calibrated regularly and traceable to the National Primary Standards.  $4\pi$  geometry was used during measurement. The product was operated in its intended orientation in application and was recorded in this report.

### **3.5 Goniophotometer System**

The goniophotometer system is calibrated by standard light source before measurement. The standard light source has been calibrated regularly and traceable to the National Primary Standards.

Type C goniophotometer was used for measuring total luminous flux, luminous intensity distribution, and color spatial uniformity. The product was operated in its intended orientation in application and was recorded in this report. The method according to IESNA LM-79-08 following chapter.

---

## 4-Test Result

---

### 4.1 Photometric test with Integrating Sphere System

#### 4.1.1 Model: 71712

##### Electrical data

Input Voltage (V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
120.0	60	1.0209	122.02	0.996

##### Photometric data

Luminous Flux (lm)	Radiant Flux (W)	Efficacy (lm/W)	CCT (K)	Duv
15198.188	30.05	125.129	5244	0.0006

##### Chromaticity Coordinate

x	y	u	v	u'	v'
0.3387	0.3476	0.2086	0.3211	0.2086	0.4817


##### Color Rendering Details

Ra
82.6

R1	R2	R3	R4	R5
82	89	91	80	80
R6	R7	R8	R9	R10
82	87	69	13	71
R11	R12	R13	R14	R15
78	53	85	95	78



### Spectral Distribution

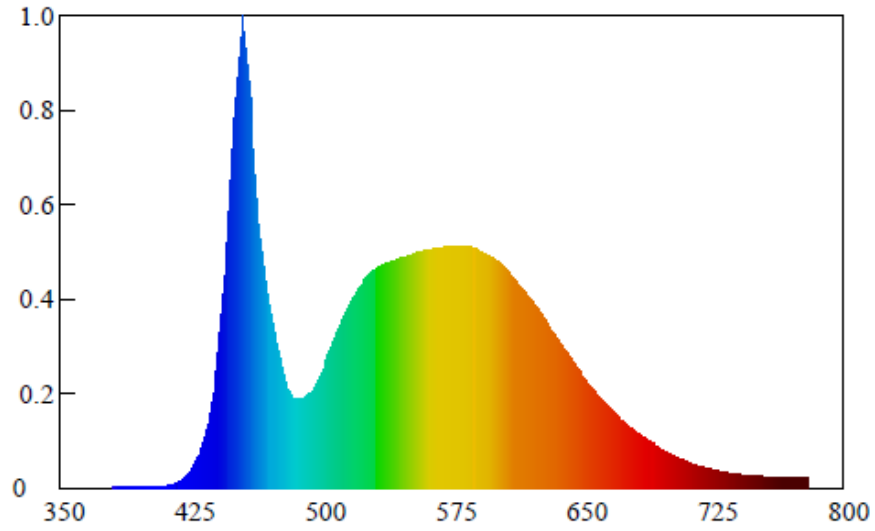


光谱分布 Spectral Distribution

### Chromaticity Diagram (CIE 1931)



## ANSI Chromaticity Quadrangles Diagram

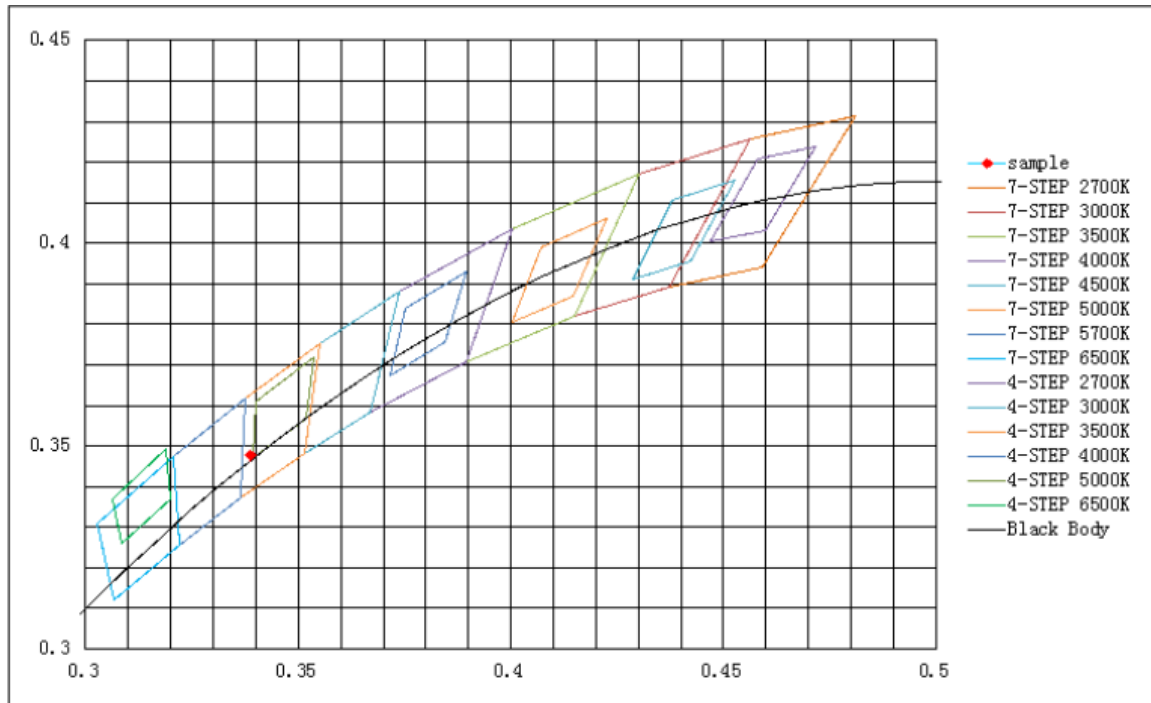

---

## 4.2 Photometric test with Goniophotometer System

### 4.2.1 Model: 71712

#### Electrical Measurement

Input Voltage (V)	Frequency (Hz)	Input Current (A)	Power (W)	Power Factor
119.93	60	1.0180	121.61	0.996

#### Photometric Measurement

Luminous Flux (lm)	Efficacy (lm/W)	CBCP (cd)	Zonal Lumen Density(20~50° )
15299.36	125.81	5731.228	57.496%

---

## Zonal Lumen Summary



### ZONAL LUMEN SUMMARY

Zone	Lumens	%Fixt
0-30	4877.86	31.88%
0-40	8011.52	52.37%
0-60	13320.38	87.06%
0-90	15271.60	99.82%
0-120	15281.30	99.88%
0-180	15299.36	100.00%
60-90	2984.59	19.51%
90-120	38.84	0.25%
90-130	42.93	0.28%
90-150	51.28	0.34%
90-180	56.74	0.37%
0-54.81	12239.49	80.00%

### ZONAL LUMEN SUMMARY

0-10	550.68
10-20	1674.64
20-30	2652.55
30-40	3133.66
40-50	3010.27
50-60	2298.59
60-70	1282.80
70-80	538.57
80-90	129.85
90-100	3.79
100-110	2.59
110-120	3.31
120-130	4.09
130-140	4.37
140-150	3.98
150-160	3.08
160-170	1.90
170-180	0.48

**Light Distribution Curve [Unit: cd]**

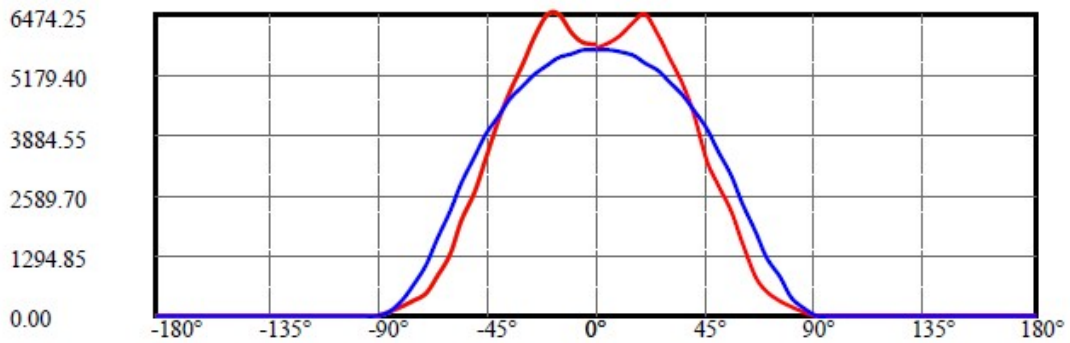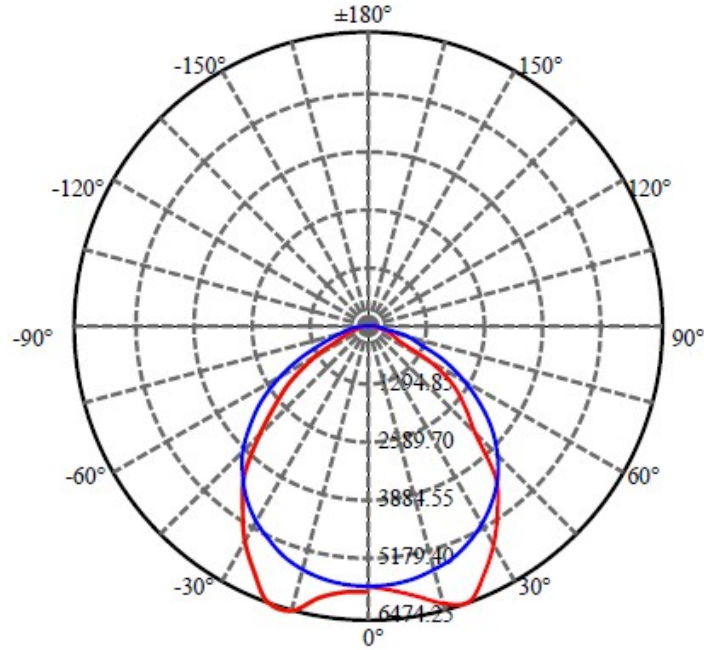

C180(Max): ———  
 C0/C180: ———  
 C90/C270: ———

Field angle(10%Imax):C0/180Left:52.5 Right:82.9  
 :C90/270Left:76.3 Right:78.2

Beam Angle(50%Imax):C0/180Left:31.0 Right:61.0  
 :C90/270Left:55.1 Right:56.3

### Luminous Intensity (cd) Distribution Data

C/γ(°)	0.0	5.0	10.0	15.0	20.0	25.0	30.0	35.0	40.0
0.0	5731.23	5856.42	6012.50	6332.80	6458.00	6022.26	5539.37	4993.08	4347.60
22.5	5721.47	5734.48	5830.41	6049.90	6300.29	6036.89	5542.63	5023.97	4450.03
45.0	5710.09	5703.59	5718.22	5781.63	5890.56	5991.37	5765.37	5277.61	4742.69
67.5	5690.58	5677.57	5635.30	5568.64	5474.34	5350.77	5202.82	5049.98	4832.12
90.0	5726.35	5714.97	5666.19	5570.27	5436.94	5248.34	5015.84	4729.69	4415.89
112.5	5736.11	5740.98	5724.72	5692.21	5651.56	5619.04	5571.89	5384.92	4993.08
135.0	5752.36	5781.63	5840.16	5983.24	6220.62	6136.07	5723.10	5193.06	4565.47
157.5	5799.51	5851.54	5983.24	6368.57	6438.49	6045.02	5474.34	4866.26	4285.82
180.0	5836.91	5888.94	6058.03	6474.25	6461.25	5973.48	5409.30	4807.73	4228.91
202.5	5721.47	5758.87	5875.93	6210.86	6306.79	5937.71	5388.17	4776.84	4181.76
225.0	5710.09	5724.72	5752.36	5836.91	6010.88	6017.38	5671.07	5132.90	4536.21
247.5	5690.58	5679.20	5643.43	5580.02	5487.35	5352.40	5207.69	5051.61	4793.10
270.0	5726.35	5705.21	5645.06	5542.63	5397.92	5188.18	4936.17	4645.14	4315.09
292.5	5736.11	5716.60	5671.07	5630.42	5573.52	5510.11	5417.43	5261.35	4893.90
315.0	5752.36	5742.61	5781.63	5885.69	6058.03	6062.91	5666.19	5149.16	4578.48
337.5	5799.51	5804.39	5913.33	6173.47	6360.44	6009.25	5500.35	4967.06	4345.98
360.0	5731.23	5856.42	6012.50	6332.80	6458.00	6022.26	5539.37	4993.08	4347.60
C/γ(°)	45.0	50.0	55.0	60.0	65.0	70.0	75.0	80.0	85.0
0.0	3344.44	2805.78	2249.89	1551.58	831.31	509.06	334.12	195.76	80.32
22.5	3739.52	2897.32	2346.15	1710.43	1055.20	607.43	392.00	232.66	99.18
45.0	4172.01	3476.13	2685.95	1962.44	1368.99	847.08	521.58	296.40	125.19
67.5	4484.18	3933.00	3242.01	2523.37	1764.08	1151.12	705.63	388.75	151.04
90.0	4035.43	3549.30	3020.89	2412.81	1799.85	1234.04	843.83	416.23	159.01
112.5	4451.66	3809.44	3081.04	2333.14	1635.64	1042.19	637.51	357.86	132.83
135.0	3933.00	3266.39	2443.70	1773.84	1188.52	708.88	445.17	259.00	107.15
157.5	3596.45	2742.86	2113.64	1474.67	860.09	526.30	345.34	203.24	80.32
180.0	3373.70	2656.69	2064.87	1342.98	835.70	466.47	314.77	189.09	73.49
202.5	3526.53	2688.72	2061.45	1439.07	824.16	511.34	321.44	182.42	62.76
225.0	3890.73	3241.19	2439.31	1733.19	1160.07	704.17	432.65	224.05	71.21
247.5	4345.98	3718.39	3016.01	2239.16	1558.89	975.85	588.08	306.80	84.55
270.0	3889.11	3414.35	2872.77	2242.58	1639.38	1068.69	654.42	335.74	98.53
292.5	4331.35	3667.99	2951.14	2211.20	1513.86	944.96	577.35	299.16	100.48
315.0	3962.27	3228.19	2388.91	1773.67	1178.11	700.75	435.25	245.02	86.82
337.5	3560.68	2792.12	2236.89	1591.09	894.88	541.09	352.65	202.58	81.94
360.0	3344.44	2805.78	2249.89	1551.58	831.31	509.06	334.12	195.76	80.32
C/γ(°)	90.0	95.0	100.0	105.0	110.0	115.0	120.0	125.0	130.0
0.0	6.34	2.44	1.63	1.63	1.95	2.44	2.76	3.41	3.90
22.5	11.54	2.76	2.11	1.95	2.44	2.76	3.09	3.58	4.23
45.0	13.17	2.60	2.11	2.11	2.44	3.09	3.74	4.55	5.04
67.5	10.08	2.60	2.28	2.44	2.60	3.25	3.90	4.72	5.20
90.0	10.08	2.28	2.28	2.60	2.93	3.58	4.39	5.20	6.02
112.5	9.59	2.44	2.28	2.44	2.93	3.58	4.23	4.88	5.69
135.0	8.13	2.60	2.28	2.28	2.76	3.41	4.23	4.88	5.53
157.5	6.99	2.93	2.28	2.28	2.60	3.09	3.58	3.90	4.72
180.0	5.04	2.93	2.11	1.95	2.11	2.60	2.93	3.58	4.06
202.5	4.06	2.28	2.11	2.28	2.60	3.25	3.74	4.23	4.88
225.0	3.58	2.11	2.11	2.44	3.09	3.74	5.04	5.53	5.69
247.5	2.44	2.11	2.44	3.25	3.58	3.90	4.88	5.85	6.18
270.0	2.11	2.28	2.93	3.58	3.90	4.39	4.88	5.85	6.34
292.5	3.41	2.11	2.28	2.76	3.90	3.90	4.23	4.88	5.85
315.0	6.02	2.28	2.11	2.28	2.60	3.41	4.06	4.72	5.04
337.5	5.69	2.60	1.95	2.11	2.28	2.76	3.25	3.74	4.23
360.0	6.34	2.44	1.63	1.63	1.95	2.44	2.76	3.41	3.90

C/γ(°)	135.0	140.0	145.0	150.0	155.0	160.0	165.0	170.0	175.0
0.0	4.72	5.04	5.53	5.69	5.85	6.02	6.02	6.18	6.34
22.5	4.88	5.37	5.85	6.18	6.18	6.34	6.50	6.50	6.50
45.0	5.69	6.02	6.18	6.50	6.83	6.83	6.83	6.67	6.67
67.5	6.18	6.50	6.83	6.99	6.99	7.15	6.99	6.99	6.83
90.0	6.34	7.15	7.32	7.48	7.48	7.48	7.32	7.15	6.99
112.5	6.18	6.67	6.99	7.15	7.48	7.48	7.48	7.15	6.99
135.0	6.02	6.34	6.50	6.67	6.99	7.15	7.15	7.15	6.99
157.5	5.20	5.69	6.18	6.34	6.50	6.50	6.50	6.83	6.99
180.0	4.72	5.37	6.02	6.02	6.18	6.34	6.34	6.18	6.34
202.5	5.37	5.85	5.85	5.85	6.02	6.02	6.02	6.34	6.67
225.0	6.02	6.18	6.34	6.50	6.50	6.67	6.67	6.67	6.67
247.5	6.50	6.67	6.99	6.99	7.15	7.15	6.99	6.67	6.50
270.0	6.83	6.99	7.15	7.32	7.32	7.15	6.99	6.83	6.83
292.5	6.02	6.34	6.67	6.83	6.83	6.83	6.83	6.67	6.83
315.0	5.53	5.85	6.02	6.18	6.50	6.50	6.34	6.50	6.67
337.5	4.88	5.20	5.53	5.85	5.85	6.02	6.34	6.34	6.50
360.0	4.72	5.04	5.53	5.69	5.85	6.02	6.02	6.18	6.34

C/γ(°)	180.0
0.0	6.99
22.5	6.50
45.0	6.83
67.5	6.83
90.0	6.99
112.5	6.99
135.0	6.83
157.5	6.83
180.0	6.99
202.5	6.50
225.0	6.83
247.5	6.83
270.0	6.99
292.5	6.99
315.0	6.83
337.5	6.83
360.0	6.99

Ambotek

---

## 5-Additional Test

---

Test item	Test Voltage (V)	Frequency(Hz)	Test Result
Power Factor	277	60	0.915
Total harmonic Distortion	277	60	16.48%
Off State Power (W)	120	60	0

*The test data was only good for the test sample. It may have deviation for other test sample.*




---

**Attachment A – Product PHOTO**

---

**FRONT PHOTO**

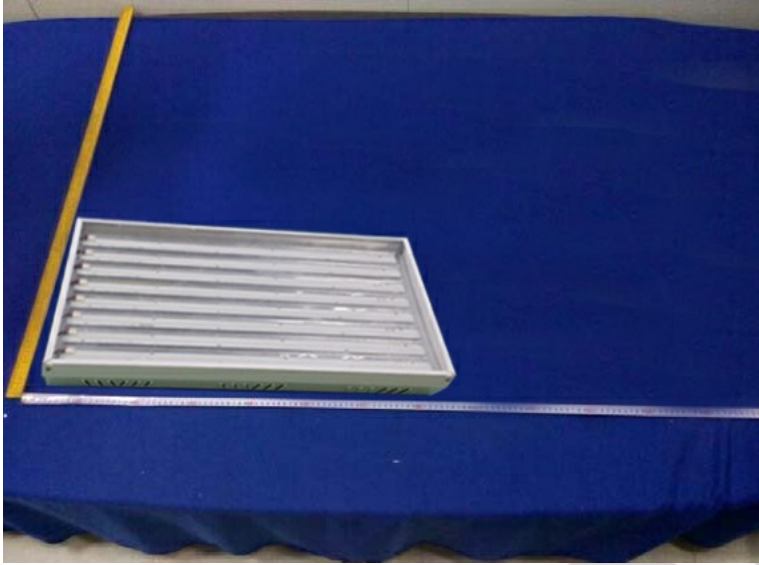

**REVERSE PHOTO**



**PHOTO**

-----End of Report-----